


PROVIDE NEW INTERIOR
PROTECTIVE LINER OR
COATING AS SPECIFIED IN
DETAIL NOTES

MATCH INVERT OF
EFFLUENT

NOTES:

1. PROVIDE FIBERGLASS LINER FOR INSIDE WALL OF MANHOLE WHEN FORCE MAIN IS 4 INCHES OR LARGER IN DIAMETER.
2. WHEN FORCE MAIN IS LESS THAN 4 INCHES IN DIAMETER, THE INTERIOR MANHOLE SURFACE SHALL BE COATED WITH SEWPERCOAT OR SPECTRASHIELD PROTECTIVE COATING SYSTEM.

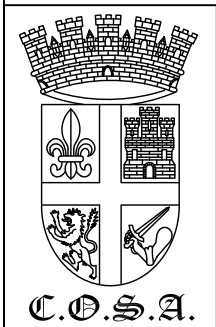

TYPICAL FORCE MAIN CONNECTION TO MANHOLE

REVISION
DATE:

FEB 2017

NOT TO
SCALE

SS-18