


NOTES:

1. POURED IN PLACE (NOT PRECAST) CONCRETE SHALL BE FLUSH WITH GRADE.
2. COVER SHALL BE STAMPED "WATER" OR "SEWER" AS APPROPRIATE.
3. ALL UNDERGROUND VALVES SHALL BE INSTALLED WITH AN ADJUSTABLE CAST IRON VALVE BOX WITH TOP SET TO FINAL GRADE. ALL VALVES SHALL HAVE ELECTRONIC MARKER BLUE FOR WATER AND GREEN FOR SEWER SEE W-57.
4. ALL UNDERGROUND VALVES SHALL BE INSTALLED SO THAT THE OPERATING NUT IS ACCESSIBLE USING A STANDARD VALVE KEY. VALVE EXTENSIONS SHALL BE INSTALLED AS NECESSARY SO THAT THE OPERATING NUT IS A MAXIMUM OF 36" BELOW FINAL GRADE.
5. COVER SHALL BE COATED WITH ENAMLE PAINT BLUE/WATER OR GREEN/SEWER AS APPROPRIATE.

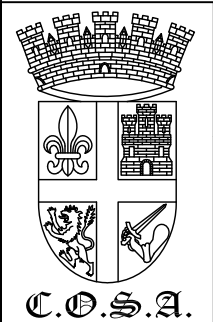

**VALVE BOX & COVER
UNPAVED LOCATION
NEW CONSTRUCTION**

REVISION
DATE:

FEB 2017

NOT TO
SCALE

SS-30&W-18