



NOTE:

FOR LOCATIONS WITH CURBING, ETCH THE LETTER "W" MINIMUM OF 2 INCHES HIGH AND 1/4 INCH DEEP IN FACE OF CURB, AND PAINT BLUE. FOR LOCATIONS WITHOUT CURBING BUT WITH SIDEWALK, ETCH THE LETTER "W" MINIMUM OF 2 INCHES HIGH AND 1/4 INCH DEEP IN FRONT OF SIDEWALK, AND PAINT BLUE. AS AN ALTERNATIVE TO ETCHING IN ALL LOCATIONS AND CONDITIONS, A STAINLESS STEEL DISC AND NAIL MAY BE USED. DISC SHALL BE 1-1/2" DIAMETER, AND ENGRAVED WITH THE WORD "WATER" CENTERED AT THE 12 O'CLOCK POSITION AND THE WORD "SERVICE" CENTERED AT THE 6 O'CLOCK POSITION ON THE DISC. NAIL AND DISC SHALL BE INSTALLED AT THE EDGE OF PAVEMENT, CURBING OR SIDEWALK DIRECTLY IN LINE WITH THE WATER SERVICE. THE CITY MAY REQUIRE OTHER MEANS OF IDENTIFICATION, SUCH AS TREATED FENCE POSTS PAINTED BLUE ON TOP TO MARK SERVICES FOR FUTURE DEVELOPMENT.

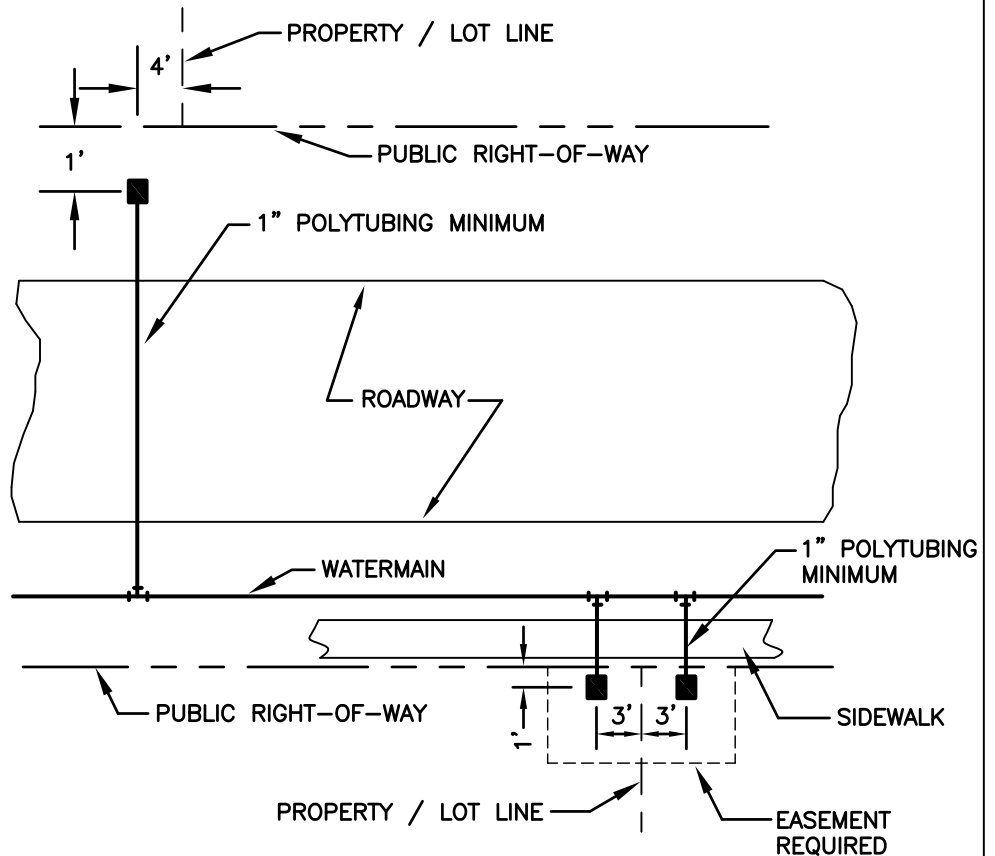

NOTES:

1. THE SKETCHES ABOVE ARE SUGGESTIONS FOR SOME TYPICAL INSTALLATIONS. ACTUAL INSTALLATIONS MAY VARY SLIGHTLY ACCORDING TO FIELD CONDITIONS. CITY INSPECTOR SHALL DIRECT METER BOX LOCATIONS FOR A-TYPICAL INSTALLATIONS.
2. IF AN EASEMENT IS LOCATED BETWEEN LOTS, METERS TO BE LOCATED 3' OUTSIDE OF EASEMENT LINE.
3. WHENEVER POSSIBLE, METER BOXES SHALL BE LOCATED OUTSIDE OF PAVEMENT.
4. METER BOXES SHALL BE INSTALLED ON LEVEL GROUND.
5. WHERE METER BOXES ARE INSTALLED ON PRIVATE PROPERTY, A UTILITY EASEMENT WILL BE REQUIRED.

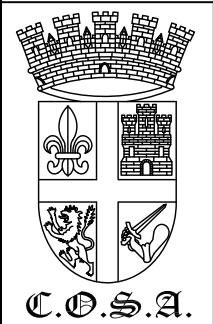

WATER METER LOCATIONS
3/4" - 2" METERS

REVISION DATE:

FEB 2017

NOT TO SCALE

W-1