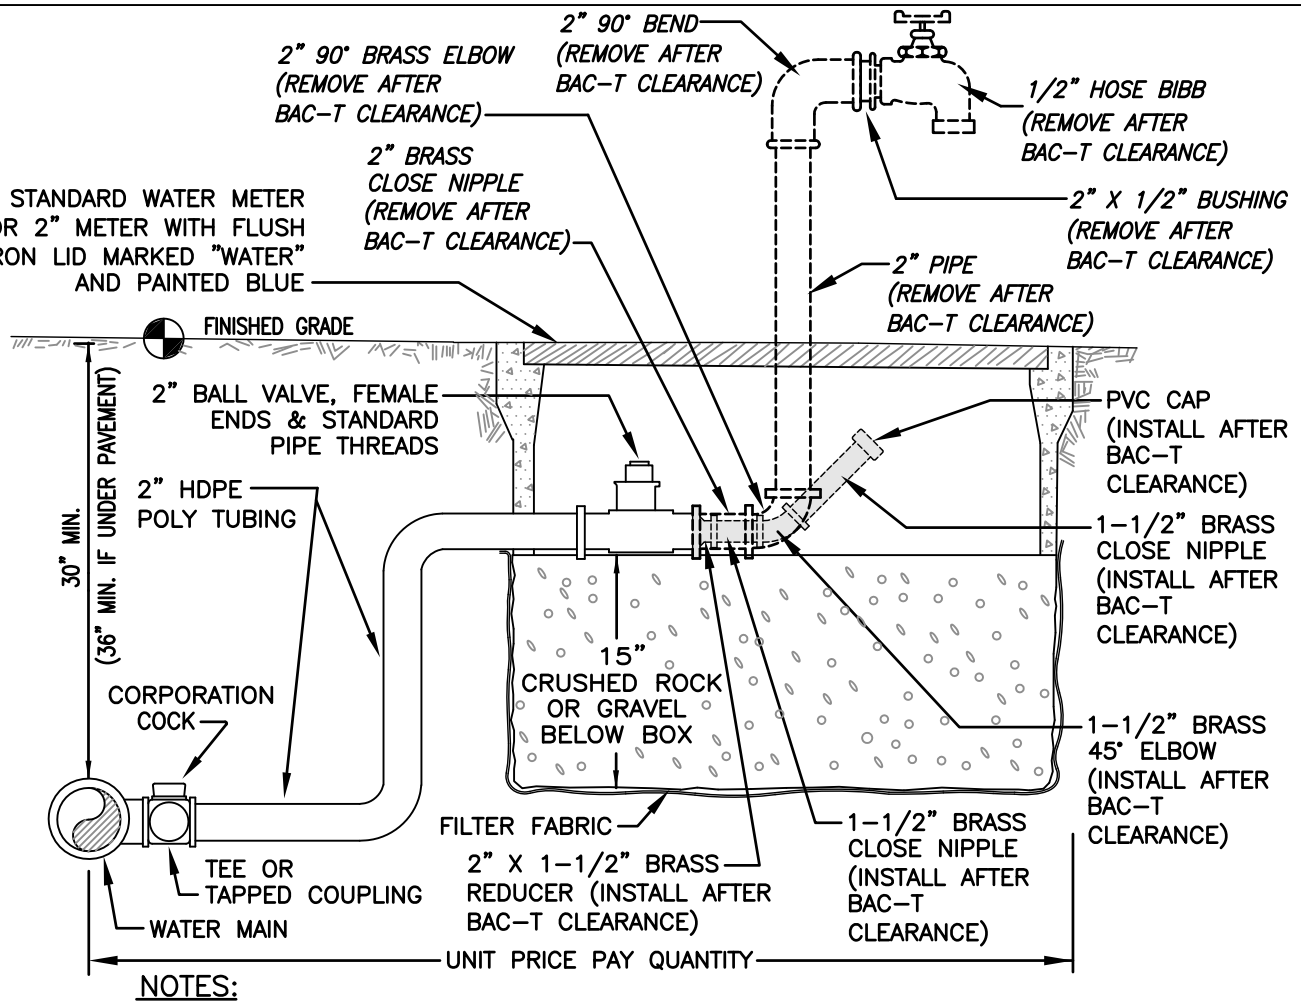

NOTES:

1) TO BE USED ONLY IN AREAS NOT SUBJECT TO FLOODING.
2) BELOW GRADE FLUSHING VALVES REQUIRED ON ALL DEAD ENDS & STUB OUTS NOT IN FLOOD AREAS. SEE ALSO BELOW GRADE FLUSHING VALVE DETAIL W-28.
3) THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE REMOVAL OF ALL PIPING & FITTINGS (AS NOTED IN THIS DETAIL) AFTER BACTERIOLOGICAL CLEARANCE IS RECEIVED.
4) THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE INSTALLATION OF ALL PIPING & FITTINGS (AS NOTED IN THIS DETAIL) AFTER BACTERIOLOGICAL CLEARANCE IS RECEIVED.

C.O.S.A.

TEMPORARY SAMPLE TAP IN BELOW GRADE FLUSHING VALVE

REVISION DATE:	FEB 2017
NOT TO SCALE	W-28A