


- NOTE: 1. LOCATE WIRE IS REQUIRED ON ALL 2" AND LARGER WATER SERVICES. SEE LOCATE WIRE DETAILS.
 2. REDUCED PRESSURE DETECTOR ASSEMBLY REQUIRED FOR CHEMICAL FIRE PROTECTION SYSTEMS OR IF CONNECTED TO AUXILIARY WATER SOURCE.

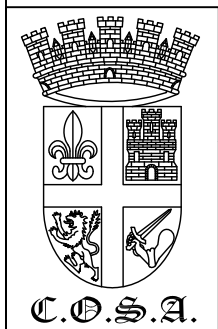

**FIRE SERVICE DOUBLE CHECK
 DETECTOR ASSEMBLY**
 3" - 10"

REVISION DATE:	FEB 2017
NOT TO SCALE	W-48