


NOTES:

1. PRECAST MANHOLE SECTIONS TO BE MANUFACTURED IN ACCORDANCE WITH LATEST EDITIONS OF ASTM C478 WITH 4000 PSI CONCRETE, TYPE II CEMENT.
2. FOR AIR RELEASE VALVES FOR USE ON WATER MAINS:
 THE INTERIOR AND EXTERIOR OF MANHOLE AND ADJUSTMENT RINGS SHALL BE GIVEN ONE COAT OF WATERPROOFING MATERIAL. CS-55 BY CONCRETE SEALANTS, INC. OR APPROVED EQUAL. DO NOT COAT JOINT OR PIPE OPENING SURFACES.

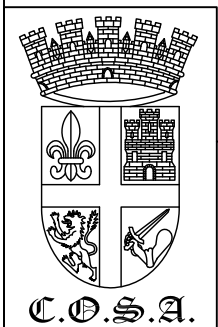

**MANHOLE DETAIL FOR
 AIR RELEASE VALVES
 ON WATER MAINS**

REVISION DATE:	FEB 2017
NOT TO SCALE	W-60